

DG-25LD



Standalone Keypad Access

- Operating voltage 12~24Vdc
- Stainless Steel
- Allows up to 49+50 PIN codes
- Backlight keypad
- Dual relays output for multi-control
- Weather resistant
- Vandal resistant
- 3 LED displays with audible indication





WEATHER
RESISTANT



STAINLESS
STEEL




VANDAL
RESISTANT

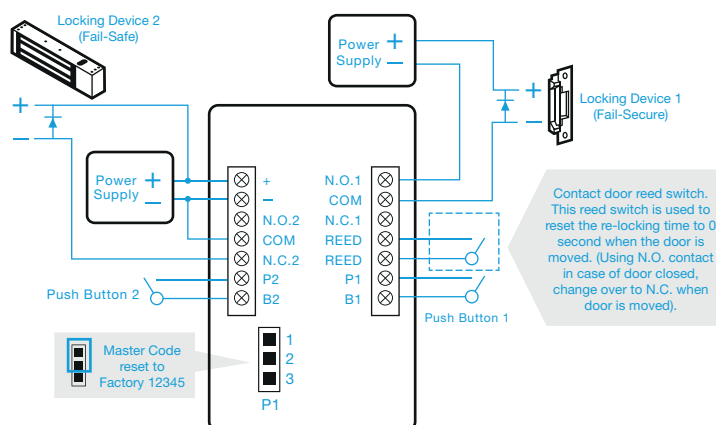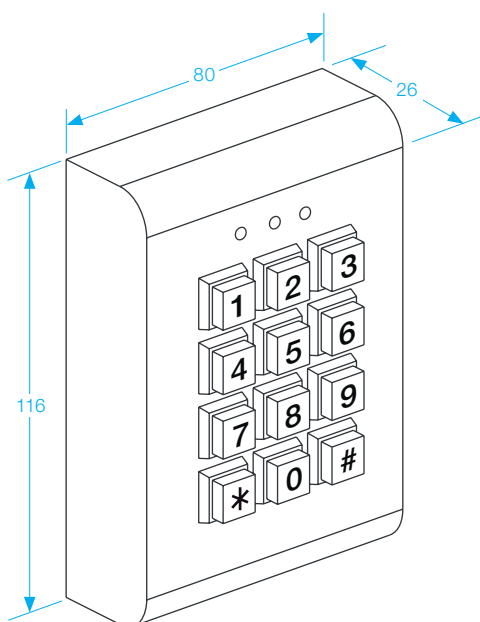


SPECIFICATION

- Current draw: Average 15mA, Peak 60mA@12Vdc.
- Input: 2 x Request-to-Exit, time out reed switch contact.
- Output: Dual relays, N.O./N.C./Com. Output (*free voltage contact*).
- Relays Rating: 2A MAX@30Vdc., 0.4A@120Vac.
- Fully programmable via keypad and master code.
- PIN codes: 5 digit codes only.
- Memory Volume: 49+50 PIN codes.
Relay 1 is controlled by 001~049 user slots.
Relay 2 is controlled by 050~099 user slots.
- Relays Activation Time: (*100,*200).
Strike Time: 1~99 seconds.
Strike mode: Access Timer or Latch.


The Digital Keyless Entry system Operation User's Manual

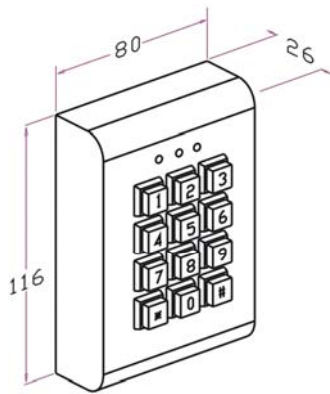

DG-25 series
(Surface mount)

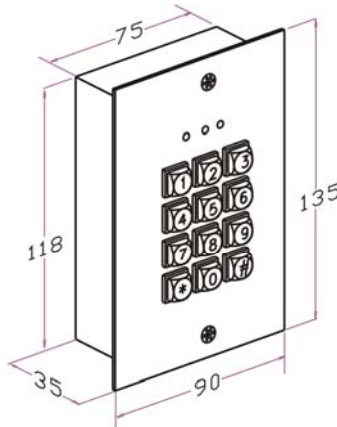

DG-26 series
(Flush mount)

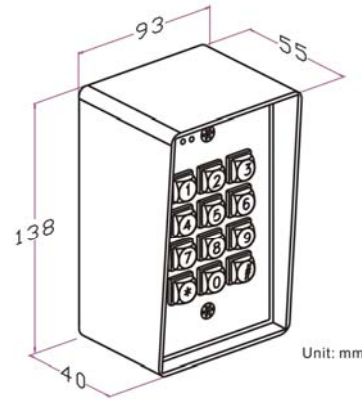

DG-27 series
(Surface mount)

1. Product Characteristic:

- ◆ Allows up to 49+50 PIN codes
- ◆ Dual relays programmable On/Off or pulsed or latched mode
- ◆ Fully Programmable via keypad and master code
- ◆ Door Reed Switch Input for Anti-Trailing
- ◆ 3 LED display with audible indication
- ◆ Non-Volatile Memory
- ◆ Invalid PIN Lock-out
- ◆ Durable Stainless Steel housing
- ◆ With vandal resistant screws

2. Specifications:

- ◆ Operating Voltage: 12~24 Vdc
- ◆ Current Draw: Average 15mA, Peak 60mA @ 12Vdc
- ◆ Input: request-to-exit · Door Reed
- ◆ Output: Dual relays, N.O./N.C./Com. Output (free voltage contact)
- ◆ Relays Electric Current: 2A MAX @30Vdc ; 0.4A @ 120Vac
- ◆ Relay Activation Time: (* 100 、 * 200)
 - Strike Time: 1~99 seconds (adjustable)
 - Strike mode: Access Timer or Latch
- ◆ Memory Volume: 49+50 PIN codes
 - Relay 1 is controlled by 001~049 user slots
 - Relay 2 is controlled by 050~099 user slots
- ◆ PIN codes: 5 digit codes only
- ◆ Operating Temperature: -20~+70°C
- ◆ Ambient Humidity: 5~95% relative humidity non-condensing
- ◆ Factory Master Code: 12345
- ◆ Invalid PIN Lock-out: The system will shut down for 60 seconds while 32 codes of incorrectly Master Codes enrolled or PIN codes attempted.
- ◆ EPROM: Non-volatile memory, System will retain all programs and codes after a total loss of power.

3. The indicator signal chart:

Sound and LED indicator:

LED signal	Green LED	Power on, stand-by
	Red LED	Relay 1 activated
	Yellow LED	Relay 2 activated
Sound signal	1 Beep	Effective PIN codes
	2 Beeps	Entering 、Exiting from the Program mode
	3 Beeps	Data computing error 、other operation mistakes
	5 Beeps	Master Code reset to Factory (12345)

4. Operation Instruction:

◆ Enter Program Mode:

1. Compose twice the master code (Factory master is 「 12345 」)
→ 2 beeps → you are now in the "programming mode".
2. After 60 seconds if you have not entered any codes or data, the system will automatically exit from the programming mode. After 32 wrong codes attempts at the master code the lockout facility will operate.

◆ Exiting from the program mode:

1. Press 「 # 」 to exit from the programming mode.
2. After 60 seconds if you have not entered any codes or data, the system will automatically exit from the programming mode. After 32 wrong codes attempts at the master code the lockout facility will operate.

◆ Add PIN codes

Enter the Programming mode, Enter the slot position code 「 * 001~* 099 」 →?????

Input 5 digit PIN codes→ (beep) enrolled → (repeat)

Press 「 # 」 to exit from the programming mode, or program other operating.

Note 1: The codes 「 00000 」 , 「 12345 」 or master code are not be used for PIN code.

Note 2: Relay 1 is controlled by 001~049 user slots, Relay 2 is controlled by 050~099 user slots

◆ To Delete a User Code :

Enter the Programming mode→ Press the slot position code of your choice to delete (example "06") →Press 「 * 006 」 → 「 00000 」 → (beep) →delete→Press 「 # 」 to exit from the programming mode, or programming other operating.


◆ To Program Relocking Timer

Enter the Programming mode,

- A. Relay 1 : Press 「 * 100 」 Followed by the number of seconds the relay should open→ 「 05 」 =5 seconds (01 ~99 = seconds) → (beep) →enrolled → Press 「 # 」 to exit from the programming mode, or program other operating.
- B. Enter 「 00 」 Sets the relay to latching mode. (Correct code entered opens the relay, and the relay stays open until the correct code is entered again).
- C. Relay 2 : Press 「 * 200 」 Followed by the number of seconds the relay should open) → 「 05 =5 seconds (01 ~99 = seconds). → (beep) →enrolled → Press 「 # 」 to exit from the programming mode, or program other operating.
- D. Enter 「 00 」 Sets the relay to latching mode. (Correct code entered opens the relay, and the relay stays open until the correct code is entered again).

- ◆ **Changing the Master codes:**
Enter the Programming mode, Enter 「 * 000 」 Followed by the new 5 digit master code → (beep) → enrolled → Enter 「 # 」 to exit from the programming mode, or program other operating.
- ◆ **Master Code reset to Factory 「 12345 」**
Insert the jumper P1 → 1-2 position → 5 audible beeps → Reset successful → Return
Insert the jumper to 2-3 position.

5. Wiring diagram:

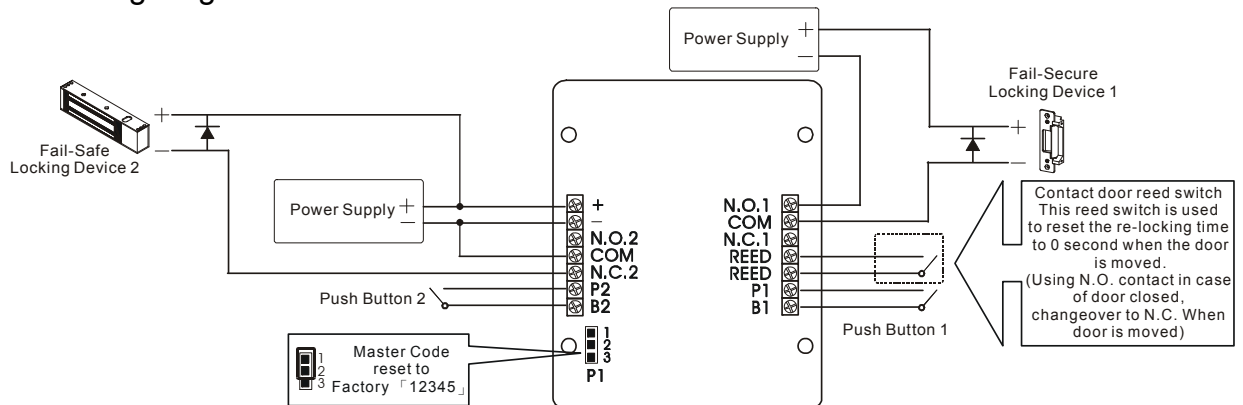

Note:

- ◆ The suggested wire gauge is #22~26 AWG.
- ◆ The varistor or diode must be connected across the lock terminal (electromagnet...) operated by the device. The varistor controls the overload produced by the strike coil (EMP).
- ◆ Egresses switch should be N.O. type.